


Select the Climate Widget

Select add Widget (+)_

HVAC Application Manager

Zone Group


Add

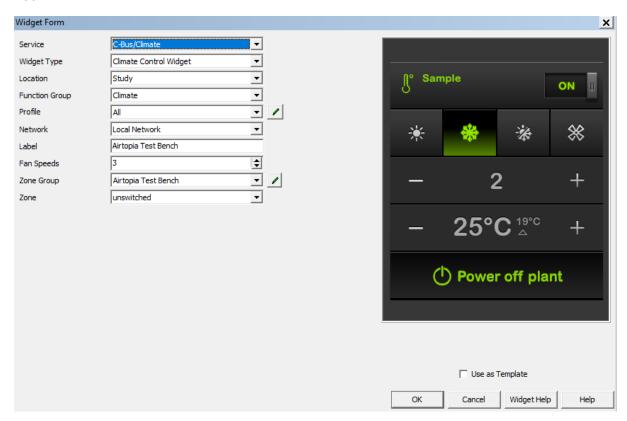



Communication Group Number must be equal to the Airtopia CBUS Unit Address (Change or edit the Airtopia CBus Unit Address in Toolkit. Whenever editing the Unit address in Toolkit the Airtopia Controller must be power cycled

Give it a friendly Name

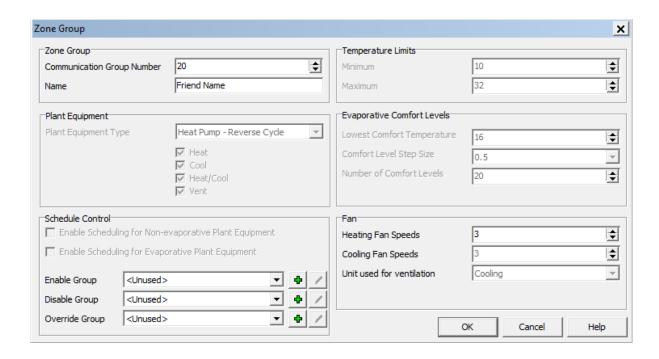

Zone TAB

Now ADD the Zone for the Airtopia Zone Group that was just created and set the Zone to unswitched

